

# Power Flow Studies

- ▶ Power flow studies are of great importance in planning and operation.
- ▶ A power flow study gives the magnitude and angle of the voltage at each bus.
- ▶ Once the bus voltage magnitudes and angles are known, the real and reactive power flow through each line can be computed and hence losses in a system.
- ▶ Power flow studies are a steady state analysis of a power system. They are called as **load flow studies**.
- ▶ Since the loads are specified in terms of power, the resulting equations are non-linear algebraic which need to be solved iteratively.
- ▶ We use numerical methods such as **Gauss-Seidal** and **Newton-Raphson** Methods for solving them.

### Power Flow Problem:

Let  $V_i$  be the voltage at  $i^{th}$  bus.

$$V_i = |V_i| \angle \delta_i$$

Let  $Y_{ii}$  and  $Y_{ij}$  be

$$Y_{ii} = |Y_{ii}| \angle \theta_{ii} \quad Y_{ij} = |Y_{ij}| \angle \theta_{ij}$$

The net current injected into the network at bus  $\textcircled{i}$  is

$$I_i = Y_{i1} V_1 + Y_{i2} V_2 + \cdots + Y_{iN} V_N = \sum_{n=1}^N Y_{in} V_n$$

where  $N$  be the total number of buses in the network. Let  $P_i$  and  $Q_i$  be the net real and reactive power entering the network at the bus  $\textcircled{i}$ .

$$P_i + jQ_i = V_i I_i^*$$

$$P_i - jQ_i = V_i^* I_i$$

$$P_i - jQ_i = V_i^* \sum_{n=1}^N Y_{in} V_n$$

On substitution,

$$P_i - jQ_i = |V_i| \underline{\angle -\delta_i} \sum_{n=1}^N |Y_{in}| |V_n| \underline{\angle \theta_{in} + \delta_n}$$

$$P_i - jQ_i = \sum_{n=1}^N |Y_{in}| |V_i| |V_n| \underline{\angle \theta_{in} + \delta_n - \delta_i}$$

Equating real and and imaginary parts,


$$P_i = \sum_{n=1}^N |Y_{in}| |V_i| |V_n| \cos(\theta_{in} + \delta_n - \delta_i)$$

$$Q_i = - \sum_{n=1}^N |Y_{in}| |V_i| |V_n| \sin(\theta_{in} + \delta_n - \delta_i)$$

The above equations are power flow equations in the polar form.  
They are non linear functions of  $|V|$  and  $\delta$ .

$$P = f_1(|V|, \delta)$$

$$Q = f_2(|V|, \delta)$$

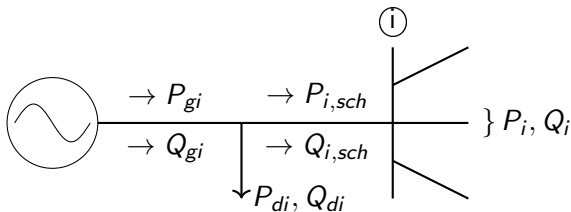

The net scheduled power injected into the network

$$P_{i,sch} = P_{gi} - P_{di}; \quad Q_{i,sch} = Q_{gi} - Q_{di}$$

The mismatch power

$$\Delta P_i = P_{i,sch} - P_i \quad \Delta Q_i = Q_{i,sch} - Q_i$$

If the calculated values match the scheduled values perfectly, the mismatches are zero at bus (i). The power balance equations

$$(P_{gi} - P_{di}) - P_i = 0$$

$$(Q_{gi} - Q_{di}) - Q_i = 0$$

At each bus ①, there are four quantities.

$$P_i, Q_i, |V_i|, \delta_i$$

Two of the four quantities are specified and the remaining two are calculated.

#### Types of Buses:

The main objective of the power flow is to find  $|V|$  and  $\delta$  of each bus when power generation and loads are specified. To facilitate this, the buses are classified into three different types.

1. Load buses (PQ)
2. Generator buses / Voltage controlled buses (PV)
3. Slack / Swing bus

1. Load buses:

At each load bus,  $P_{gi}$  and  $Q_{gi}$  are zero.  $P_{di}$  and  $Q_{di}$  are specified.

$$P_{i,sch} = -P_{di}; \quad Q_{i,sch} = -Q_{di}$$

$|V_i|$  and  $\delta_i$  are to be determined at each load bus.

2. Voltage-controlled buses:

- ▶ A bus at which the voltage magnitude is kept constant is said to be voltage controlled.
- ▶ At each generator bus,  $P_{gi}$  and  $|V_i|$  are specified.  $Q_{gi}$  and  $\delta_i$  are to be determined.
- ▶ These buses are called as generator buses.
- ▶ Buses which have voltage control capability even without generators are designated as voltage controlled buses.  $P_{gi} = 0$  for those buses.

### 3. Slack bus:

- ▶ For convenience, bus ① is almost always designated as the slack bus.
- ▶  $|V_1|$  and  $\delta_1$  are specified. Usually  $\delta_1 = 0^\circ$ .
- ▶  $P_1$  and  $Q_1$  are to be found.
- ▶ Since the losses can be found only after  $|V|$  and  $\delta$  are known at each bus, the slack bus  $P_g$  and  $Q_g$  are not specified.
- ▶ The slack bus supplies the difference between the specified power going into the network at all the other buses and the total output plus losses.
- ▶ A generator bus with the largest generating capacity is usually selected as the slack bus.

# Power Flow Studies - Methods

- ▶ The power flow equations are nonlinear functions of  $|V_i|$  and  $\delta_i$ .
- ▶ Hence, iterative techniques such as Gauss-Seidel and Newton-Raphson methods are used to solve them.
- ▶ Gauss- Seidel method solves the power flow equations in rectangular form.
- ▶ Newton- Raphson method solves the power flow equations in polar form.

## Gauss Seidel Method

Let  $f(x)$  be a non-linear function of one variable.

$$f(x) = 0$$

To solve it, let us rewrite  $f(x)$  as follows:

$$x = g(x)$$

where  $g$  is another function of  $x$ . (It need not be unique.)

- ▶ Assume  $x^0$ .
- ▶ Set  $k = 0$ .
- ▶ Find the next iterate

$$x^{k+1} = g(x^k)$$

- ▶ Check for convergence i.e.,  $|x^{k+1} - x^k| \leq \epsilon$ . Otherwise repeat the above step.

Let us extend it to multi- variable functions.

$$f_1(x_1, x_2) = 0$$

$$f_2(x_1, x_2) = 0$$

- ▶ Assume  $x_1^0$  and  $x_2^0$ .
- ▶ Set  $k = 0$ .
- ▶ Find the next iterate

$$x_1^{k+1} = g_1(x_1^k, x_2^k)$$

$$x_2^{k+1} = g_2(x_1^{k+1}, x_2^k)$$

- ▶ Check for convergence i.e.,  $\|x^{k+1} - x^k\| \leq \epsilon$ . Otherwise repeat the above step.
- ▶ G-S method is slow. It converges linearly.
- ▶ To accelerate convergence, an acceleration factor ( $\alpha$ ) is used.

$$x_{acc}^{k+1} = x^k + \alpha(x^{k+1} - x^k)$$

In power flow studies,  $\alpha$  is 1.6.

Example : Use G-S method to solve the following equation.

Assume  $x^0 = 2$ .  $\alpha = 1.6$

$$f(x) = x^3 - 6x^2 + 9x - 4 = 0$$

This can be written as

$$x = -\frac{1}{9}(x^3 - 6x^2 - 4)$$

First Iteration:

$$x^1 = 2.2222$$

$$x_{acc}^1 = x^1 + \alpha(x^1 - x^0) = 2 + 1.6 \times (2.2222 - 2) = 2.3556$$

It took almost 10 iterations to reach a solution.

$$x_{acc}^{10} \approx 4$$

- ▶ G-S Method is slow.
- ▶ It requires less computations per iteration.

Example : Use Gauss-Seidal method to find the solution of the following equations

$$x_1 + x_1x_2 = 10$$

$$x_1 + x_2 = 6$$

with  $x_1^0 = 1$  and  $x_2^0 = 1$ .

The functions can be rewritten as

$$x_1 = \frac{10}{1 + x_2}$$

$$x_2 = 6 - x_1$$

The general form of G-S Method

$$x_1^{k+1} = \frac{10}{1 + x_2^k}$$

$$x_2^{k+1} = 6 - x_1^{k+1}$$

First Iteration:

$$x_1^1 = 10/2 = 5$$

$$x_2^1 = 6 - 5 = 1$$

It took 2 iterations to reach the solution.

$$x = \begin{bmatrix} 5 \\ 1 \end{bmatrix}$$

Suppose we start with  $x^0 = \begin{bmatrix} 0 \\ 0 \end{bmatrix}$ . We will reach the following solution in 15 iterations.

$$x = \begin{bmatrix} 2 \\ 4 \end{bmatrix}$$

## Gauss-Seidel Method - Power Flow Studies:

$$P_{i,sch} - jQ_{i,sch} = V_i^* \sum_{n=1}^N Y_{in} V_n$$

where  $P_{i,sch} = P_{gi} - P_{di}$  and  $Q_{i,sch} = Q_{gi} - Q_{di}$ .

$$\frac{P_{i,sch} - jQ_{i,sch}}{V_i^*} = Y_{i1} V_1 + \dots + Y_{ii} V_i + \dots + Y_{iN} V_N$$

It can be rewritten as

$$V_i = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_{i,sch}}{V_i^*} - (Y_{i1} V_1 + \dots + Y_{iN} V_N) \right)$$
$$V_i = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_{i,sch}}{V_i^*} - \sum_{\substack{n=1 \\ n \neq i}}^N Y_{in} V_n \right)$$

In general,

$$V_i^{k+1} = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_{i,sch}}{(V_i^k)^*} - \sum_{n=1}^{i-1} Y_{in} V_n^{k+1} - \sum_{n=i+1}^N Y_{in} V_n^k \right)$$

When a system has only  $PQ$  (load) buses,

1. Form  $Y_{bus}$  matrix from the line data.
2. Assume  $V_i = 1 + j0$  for all  $PQ$  buses. It is called a *flat start*
3. Update voltages of load buses using the following equation.

$$V_i^{k+1} = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_{i,sch}}{(V_i^k)^*} - \sum_{n=1}^{i-1} Y_{in} V_n^{k+1} - \sum_{n=i+1}^N Y_{in} V_n^k \right)$$

4. Accelerate the voltage to improve convergence.

$$V_{i,acc}^{k+1} = V_i^k + \alpha(V_i^{k+1} - V_i^k)$$

5. Check for convergence  $|V_{i,acc}^{k+1} - V_i^k| \leq \epsilon$ .
6. If yes, stop. Otherwise go to step 3.

When a system has both  $PQ$  and  $PV$  (voltage controlled) buses,

1. Form  $Y_{bus}$  matrix from the line data.
2. Assume  $V_i = 1 + j0$  for all load buses.  $\delta_i = 0$  for all  $PV$  buses.
3. If the bus is  $PQ$ ,
  - Update voltages of load buses using the following equation.

$$V_i^{k+1} = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_{i,sch}}{(V_i^k)^*} - \sum_{n=1}^{i-1} Y_{in} V_n^{k+1} - \sum_{n=i+1}^N Y_{in} V_n^k \right)$$

4. If the bus is  $PV$ , ( $Q_i$  is not given in  $PV$  buses.)
  - Find  $Q_i$  using the following equation

$$Q_i^{k+1} = -\text{Imag} \left\{ (V_i^k)^* \left( \sum_{n=1}^{i-1} Y_{in} V_n^{k+1} + \sum_{n=i}^N Y_{in} V_n^k \right) \right\}$$

- If  $Q_{i,min} \leq Q_i^{k+1} \leq Q_{i,max}$ , update the voltage as follows:

$$V_i^{k+1} = \frac{1}{Y_{ii}} \left( \frac{P_{i,sch} - jQ_i^{k+1}}{(V_i^k)^*} - \sum_{n=1}^{i-1} Y_{in} V_n^{k+1} - \sum_{n=i+1}^N Y_{in} V_n^k \right)$$

Since  $|V_i|$  is given,

$$V_{i,corr}^{k+1} = |V_i| \frac{V_i^{k+1}}{|V_i^{k+1}|}$$

- Else, set  $Q_i$  to the violated limit.

$$Q_i = Q_{i,min} \text{ if } Q_i < Q_{i,min}$$

$$Q_i = Q_{i,max} \text{ if } Q_i > Q_{i,max}$$

Treat the bus as PQ bus and update the voltage (both magnitude and angle) accordingly for this iteration.


5. Accelerate the voltage to improve convergence.

$$V_{i,acc}^{k+1} = V_i^k + \alpha(V_i^{k+1} - V_i^k)$$

6. Check for convergence  $|V_{i,acc}^{k+1} - V_i^k| \leq \epsilon$ .
7. If yes, stop. Otherwise go to step 3.
8. Find the line flows, losses and the slack bus power.

Example :

Table: Line data

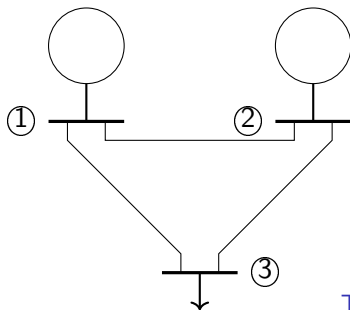

Bus Code	R (p.u.)	X (p.u.)	$\frac{Y}{2}$ (p.u.)
1-2	0	$j$ 0.1	$j$ 0.01
1-3	0	$j$ 0.1	$j$ 0.01
2-3	0	$j$ 0.1	$j$ 0.01

Table: Bus data

Bus	$P_g$	$Q_g$	$P_d$	$Q_d$	$ V $	$\delta$	Type
1	—	—	—	—	1	0	Slack
2	0.6661	—	—	—	1.05	—	PV
3	—	—	2.8653	1.2244	—	—	PQ

Assume a flat voltage start, determine the voltage at the end of first iteration using G-S method.  $0.2 \leq Q_2 \leq 2$ . Take  $\alpha = 1.6$ .

1. Form  $Y_{bus}$  matrix.

$$Y_{bus} = \begin{bmatrix} \frac{1}{j0.1} + \frac{1}{j0.1} + j0.01 + j0.01 & -\frac{1}{j0.1} & -\frac{1}{j0.1} \\ -\frac{1}{j0.1} & \frac{1}{j0.1} + \frac{1}{j0.1} + j0.01 + j0.01 & -\frac{1}{j0.1} \\ -\frac{1}{j0.1} & -\frac{1}{j0.1} & \frac{1}{j0.1} + \frac{1}{j0.1} + j0.01 + j0.01 \end{bmatrix}$$

$$Y_{bus} = \begin{bmatrix} -j19.98 & j10 & j10 \\ j10 & -j19.98 & j10 \\ j10 & j10 & -j19.98 \end{bmatrix}$$

2. Start the first iteration  $k = 0$ .

► Bus ② is a  $PV$  bus.

► Find  $Q_2$ .

$$Q_2^1 = -\text{Imag} \left\{ (V_2^0)^* \left( Y_{21} V_1^1 + Y_{22} V_2^0 + Y_{23} V_3^0 \right) \right\}$$

$$= -\text{Imag} \left\{ (1.05 + j0)^* \times (j10(1 + j0) + (-j19.98)(1.05 + j0) + j10(1 + j0)) \right\}$$

$$Q_2^1 = 1.028$$

$Q_2$  is within limit. Modify  $V_2$ .

$$V_2^1 = \frac{1}{Y_{22}} \left( \frac{P_{2,sch} - jQ_2^1}{(V_2^0)^*} - Y_{21} V_1^1 - Y_{23} V_3^0 \right)$$

$$V_2^1 = \frac{1}{-j19.98} \left( \frac{0.6661 - j1.028}{(1.05 + j0)^*} - j10 \times (1 + j0) - j10 \times (1 + j0) \right)$$

$$V_2^1 = 1.0500 + j0.0318$$

Since  $|V_2|$  is fixed,

$$V_{2,corr}^1 = |V_2| \frac{V_2^1}{|V_2^1|} = 1.05 \times \frac{1.0500 + j0.0318}{1.0505} = 1.0495 + j0.0317$$

$$V_{2,corr}^1 = 1.05 / \underline{1.732^\circ}$$

► Bus ③ is a  $PQ$  bus.

► Update  $V_3$ .

$$V_3^1 = \frac{1}{Y_{33}} \left( \frac{P_{3,sch} - jQ_{3,sch}}{(V_3^0)^*} - Y_{31}V_1^1 - Y_{32}V_2^1 \right)$$

$$V_3^1 = \frac{1}{-j19.98} \left\{ \frac{-2.8653 + j1.2244}{(1 + j0)^*} - j10 \times (1 + j0) \right. \\ \left. - j10 \times (1.0495 + j0.0317) \right\}$$

$$V_3^1 = 0.9645 - j0.1275$$

$$V_{3,acc}^1 = V_3^0 + \alpha(V_3^1 - V_3^0) = (1 + j0) + 1.6 \times (0.9645 - j0.1275 - 1 - j0)$$

$$V_{3,acc}^1 = 0.9432 - j0.2040$$

### 3. Slack bus power

It took 13 iterations to converge.

$$V = \begin{bmatrix} 1.0000 + j0.0000 \\ 1.0486 - j0.0551 \\ 0.9354 - j0.1648 \end{bmatrix}$$

$$S_1 = V_1 \times I_1^*$$

$$P_1 = 2.1985; Q_1 = 0.1408$$

$$P_L = 0; Q_L = 0.5601$$

## Newton's Method :

Let  $f(x)$  be a non-linear function of one variable.

$$f(x) = 0$$

- It approximates the given function as linear and solves repeatedly.

Let  $x^0$  be the initial guess and  $\Delta x^0$  be the correction value to be added to  $x^0$  to get the actual solution.

$$f(x^0 + \Delta x^0) = 0$$

Let us expand it using Taylor's series and neglect higher order terms .

$$f(x^0) + \left. \frac{df}{dx} \right|_{x=x^0} \Delta x^0 + \dots \approx 0$$

If we neglect higher order terms,

$$\Delta x^0 = - \frac{f(x^0)}{\left. \frac{df}{dx} \right|_{x=x^0}}$$

To get the second approximation,

$$x^1 = x^0 + \Delta x^0 = x^0 - \frac{f(x^0)}{\left. \frac{df}{dx} \right|_{x=x^0}}$$

In general

$$x^{k+1} = x^k - \frac{f(x^k)}{\left. \frac{df}{dx} \right|_{x=x^k}}$$

Check for convergence i.e.,  $|x^{k+1} - x^k| \leq \epsilon$ . Otherwise repeat the above step.

Example 2: Let us solve the example 1 by Newton's Method.

$$f(x) = x^3 - 6x^2 + 9x - 4 = 0$$

$$\frac{df}{dx} = 3x^2 - 12x + 9$$

Assume  $x^0 = 2$ .

$$\Delta x^0 = -\frac{-2}{-3} = -0.6667$$

$$x^1 = x^0 + \Delta x^0 = 2 - 0.6667 = 1.3333$$

It took 10 iterations to reach another solution.

$$x^{10} = 1.006$$


Assume  $x^0 = 5$ .

$$\Delta x^0 = -\frac{-2}{-3} = -0.6667$$

$$x^1 = x^0 + \Delta x^0 = 5 - 0.6667 = 4.3333$$

It took 5 iterations to reach the first solution.

$$x^5 = 4$$

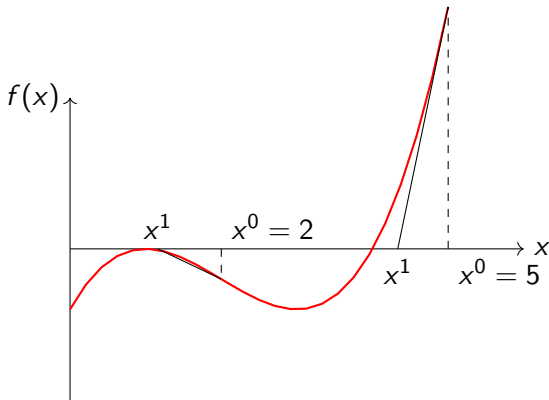

If  $x^0 = 3$ , Newton's method will fail for this problem because  $\frac{df}{dx} = 0$  at  $x^0 = 3$ .

## Newton-Raphson Method:

$$f_1(x_1, x_2) = 0$$

$$f_2(x_1, x_2) = 0$$

Let  $x^0$  be the initial guess and  $\Delta x^0$  be the correction value to be added to  $x^0$  to get the actual solution.

$$f_1(x_1^0 + \Delta x_1^0, x_2^0 + \Delta x_2^0) = 0$$

$$f_2(x_1^0 + \Delta x_1^0, x_2^0 + \Delta x_2^0) = 0$$

Let us expand it using Taylor's series and neglect higher order terms.

$$f_1(x_1^0, x_2^0) + \left. \frac{\partial f_1}{\partial x_1} \right|_{(x_1^0, x_2^0)} \Delta x_1^0 + \left. \frac{\partial f_1}{\partial x_2} \right|_{(x_1^0, x_2^0)} \Delta x_2^0 + \dots \approx 0$$

$$f_2(x_1^0, x_2^0) + \left. \frac{\partial f_2}{\partial x_1} \right|_{(x_1^0, x_2^0)} \Delta x_1^0 + \left. \frac{\partial f_2}{\partial x_2} \right|_{(x_1^0, x_2^0)} \Delta x_2^0 + \dots \approx 0$$

If we neglect higher order terms,

$$\begin{bmatrix} \frac{\partial f_1}{\partial x_1} & \frac{\partial f_1}{\partial x_2} \\ \frac{\partial f_2}{\partial x_1} & \frac{\partial f_2}{\partial x_2} \end{bmatrix}_{(x_1^0, x_2^0)} \begin{bmatrix} \Delta x_1^0 \\ \Delta x_2^0 \end{bmatrix} = \begin{bmatrix} 0 - f_1(x_1^0, x_2^0) \\ 0 - f_2(x_1^0, x_2^0) \end{bmatrix}$$

The *Jacobian* matrix is

$$J = \begin{bmatrix} \frac{\partial f_1}{\partial x_1} & \frac{\partial f_1}{\partial x_2} \\ \frac{\partial f_2}{\partial x_1} & \frac{\partial f_2}{\partial x_2} \end{bmatrix}$$

The mismatch vector  $\Delta f$  is

$$\Delta f = \begin{bmatrix} 0 - f_1(x_1, x_2) \\ 0 - f_2(x_1, x_2) \end{bmatrix}$$

Therefore, the mismatch equations are

$$J^0 \Delta x^0 = \Delta f^0$$

By solving for  $\Delta x^0$ , we get the next estimates.

$$x^1 = x^0 + \Delta x^0$$

In general

$$x^{k+1} = x^k + \Delta x^k$$

The above process is repeated till  $\|\Delta x^k\| \leq \epsilon$ .

- ▶ Every iteration, J has to be formed.
- ▶  $\Delta x$  has to be found by solving the mismatch equations either by inverse or triangular factorization.

Example 3: Consider the following nonlinear equations.

$$\begin{aligned}4x_2 \sin x_1 &= -0.6 \\ 4x_2^2 - 4x_2 \cos x_1 &= -0.3\end{aligned}$$

Find  $x_1$  and  $x_2$ . Assume  $x_1^0 = 0$  rad and  $x_2^0 = 1$ .

$$\Delta f = \begin{bmatrix} -0.6 - 4x_2 \sin x_1 \\ -0.3 - 4x_2^2 + 4x_2 \cos x_1 \end{bmatrix}$$
$$J = \begin{bmatrix} \frac{\partial f_1}{\partial x_1} & \frac{\partial f_1}{\partial x_2} \\ \frac{\partial f_2}{\partial x_1} & \frac{\partial f_2}{\partial x_2} \end{bmatrix} = \begin{bmatrix} 4x_2 \cos x_1 & 4 \sin x_1 \\ 4x_2 \sin x_1 & 8x_2 - 4 \cos x_1 \end{bmatrix}$$

First Iteration:

$$J^0 \Delta x^0 = \Delta f^0$$
$$\begin{bmatrix} 4 & 0 \\ 0 & 4 \end{bmatrix} \begin{bmatrix} \Delta x_1^0 \\ \Delta x_2^0 \end{bmatrix} = \begin{bmatrix} -0.6 \\ -0.3 \end{bmatrix}$$

$$\begin{bmatrix} \Delta x_1^0 \\ \Delta x_2^0 \end{bmatrix} = \begin{bmatrix} 4 & 0 \\ 0 & 4 \end{bmatrix}^{-1} \begin{bmatrix} -0.6 \\ -0.3 \end{bmatrix} = \begin{bmatrix} -0.150 \\ -0.075 \end{bmatrix}$$

$$\begin{bmatrix} x_1^1 \\ x_2^1 \end{bmatrix} = \begin{bmatrix} x_1^0 \\ x_2^0 \end{bmatrix} + \begin{bmatrix} \Delta x_1^0 \\ \Delta x_2^0 \end{bmatrix} = \begin{bmatrix} -0.15 \\ 0.925 \end{bmatrix}$$

It converged after 3 iterations.

$$x_1^4 = -0.1668 \text{ rad}; \quad x_2^4 = 0.9030$$

- ▶ N-R method converges fast if the starting point is near a solution.
- ▶ It takes a few iterations to converge irrespective of system variables.
- ▶ But it requires a lot of computations per iteration (Calculation of J and either inverse or triangular factorization).
- ▶ It does not converge to a solution from an arbitrary starting point.

## N-R Method - Power Flow Studies

$$P_i = \sum_{n=1}^N |Y_{in}| |V_i| |V_n| \cos(\theta_{in} + \delta_n - \delta_i)$$
$$Q_i = - \sum_{n=1}^N |Y_{in}| |V_i| |V_n| \sin(\theta_{in} + \delta_n - \delta_i)$$

They are non linear functions of  $|V|$  and  $\delta$ .

$$P = f_1(|V|, \delta)$$

$$Q = f_2(|V|, \delta)$$

By N-R method, the mismatch equations are

$$\begin{bmatrix} \Delta P \\ \Delta Q \end{bmatrix} = \begin{bmatrix} J_1 & J_2 \\ J_3 & J_4 \end{bmatrix} \begin{bmatrix} \Delta \delta \\ \Delta |V| \end{bmatrix}$$

where

$$\Delta P = P^{\text{sch}} - P^{\text{cal}}; \quad \Delta Q = Q^{\text{sch}} - Q^{\text{cal}}$$

$J_1$ ,  $J_2$ ,  $J_3$  and  $J_4$  are sub matrices of Jacobian.

$$J_1 = \left[ \frac{\partial P}{\partial \delta} \right]; \quad J_2 = \left[ \frac{\partial P}{\partial |V|} \right]; \quad J_3 = \left[ \frac{\partial Q}{\partial \delta} \right]; \quad J_4 = \left[ \frac{\partial Q}{\partial |V|} \right];$$

To find the size of the Jacobian matrix, let us assume that there are  $m$  voltage controlled buses in the system of  $n$  buses.

- ▶ Since  $P$  is specified for  $n - 1$  buses, the size of  $\Delta P$  is  $(n - 1) \times 1$ .
- ▶ Since  $Q$  is specified for only  $PQ$  buses, the size of  $\Delta Q$  is  $(n - m - 1) \times 1$ .
- ▶ Size of  $J_1$  is  $(n - 1) \times (n - 1)$
- ▶ Size of  $J_2$  is  $(n - 1) \times (n - m - 1)$
- ▶ Size of  $J_3$  is  $(n - m - 1) \times (n - 1)$
- ▶ Size of  $J_4$  is  $(n - m - 1) \times (n - m - 1)$

The size of the Jacobian is  $(2n - m - 2) \times (2n - m - 2)$ .

To find  $J_1$ :

Off-Diagonal Elements:

$$\frac{\partial P_i}{\partial \delta_n} = -|Y_{in}||V_i||V_n| \sin(\theta_{in} + \delta_n - \delta_i) \quad i \neq n$$

Diagonal Elements :

$$\frac{\partial P_i}{\partial \delta_i} = \sum_{\substack{n=1 \\ n \neq i}}^N |Y_{in}||V_i||V_n| \sin(\theta_{in} + \delta_n - \delta_i)$$

To find  $J_2$ :

Off-Diagonal Elements:

$$\frac{\partial P_i}{\partial |V_n|} = |Y_{in}||V_i| \cos(\theta_{in} + \delta_n - \delta_i) \quad i \neq n$$

Diagonal Elements:

$$\frac{\partial P_i}{\partial |V_i|} = 2|Y_{ii}||V_i| \cos(\theta_{ii}) + \sum_{\substack{n=1 \\ n \neq i}}^N |Y_{in}||V_n| \cos(\theta_{in} + \delta_n - \delta_i)$$

To find  $J_3$ :

Off-Diagonal Elements:

$$\frac{\partial Q_i}{\partial \delta_n} = -|Y_{in}||V_i||V_n| \cos(\theta_{in} + \delta_n - \delta_i) \quad i \neq n$$

Diagonal Elements:

$$\frac{\partial Q_i}{\partial \delta_i} = \sum_{\substack{n=1 \\ n \neq i}}^N |Y_{in}||V_i||V_n| \cos(\theta_{in} + \delta_n - \delta_i)$$

To find  $J_4$ :

Off-Diagonal Elements:


$$\frac{\partial Q_i}{\partial |V_n|} = -|Y_{in}||V_i| \sin(\theta_{in} + \delta_n - \delta_i) \quad i \neq n$$

Diagonal Elements:

$$\frac{\partial Q_i}{\partial |V_i|} = -2|V_i||Y_{ii}| \sin(\theta_{ii}) - \sum_{\substack{n=1 \\ n \neq i}}^N |Y_{in}||V_n| \sin(\theta_{in} + \delta_n - \delta_i)$$

Example :

Table: Line data

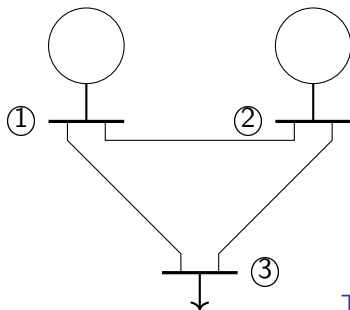

Bus Code	R (p.u.)	X (p.u.)	$\frac{Y}{2}$ (p.u.)
1-2	0	$j$ 0.1	$j$ 0.01
1-3	0	$j$ 0.1	$j$ 0.01
2-3	0	$j$ 0.1	$j$ 0.01

Table: Bus data

Bus	$P_g$	$Q_g$	$P_d$	$Q_d$	$ V $	$\delta$	Type
1	—	—	—	—	1	0	Slack
2	0.6661	—	—	—	1.05	—	PV
3	—	—	2.8653	1.2244	—	—	PQ

Assume a flat voltage start, determine the voltage at the end of first iteration using N-R method.  $0.2 \leq Q_2 \leq 2$ .

② is a *PV* bus and ③ is a *PQ* bus.

$$P_2 = |Y_{21}||V_2||V_1|\cos(\theta_{21} + \delta_1 - \delta_2) + |Y_{22}||V_2|^2\cos(\theta_{22}) \\ + |Y_{23}||V_2||V_3|\cos(\theta_{23} + \delta_3 - \delta_2)$$

$$P_3 = |Y_{31}||V_3||V_1|\cos(\theta_{31} + \delta_1 - \delta_3) + |Y_{32}||V_3||V_2|\cos(\theta_{32} + \delta_2 - \delta_3) \\ + |Y_{33}||V_3|^2\cos(\theta_{33})$$

$$Q_3 = -|Y_{31}||V_3||V_1|\sin(\theta_{31} + \delta_1 - \delta_3) - |Y_{32}||V_3||V_2|\sin(\theta_{32} + \delta_2 - \delta_3) \\ - |Y_{33}||V_3|^2\sin(\theta_{33})$$

Since,  $n = 3$  and  $m = 1$ , the mismatch equations are

$$\begin{bmatrix} \Delta P_2 \\ \Delta P_3 \\ \Delta Q_3 \end{bmatrix}_{3 \times 1} = \begin{bmatrix} \frac{\partial P_2}{\partial \delta_2} & \frac{\partial P_2}{\partial \delta_3} & \frac{\partial P_2}{\partial |V_3|} \\ \frac{\partial P_3}{\partial \delta_2} & \frac{\partial P_3}{\partial \delta_3} & \frac{\partial P_3}{\partial |V_3|} \\ \frac{\partial Q_3}{\partial \delta_2} & \frac{\partial Q_3}{\partial \delta_3} & \frac{\partial Q_3}{\partial |V_3|} \end{bmatrix}_{3 \times 3} \begin{bmatrix} \Delta \delta_2 \\ \Delta \delta_3 \\ \Delta |V_3| \end{bmatrix}_{3 \times 1}$$

1. Form  $Y_{bus}$  matrix.

$$Y_{bus} = \begin{bmatrix} 19.98 \angle -90^\circ & 10 \angle 90^\circ & 10 \angle 90^\circ \\ 10 \angle 90^\circ & 19.98 \angle -90^\circ & 10 \angle 90^\circ \\ 10 \angle 90^\circ & 10 \angle 90^\circ & 19.98 \angle -90^\circ \end{bmatrix}$$

2. Assume  $\delta_2 = \delta_3 = 0$ . and  $|V_3| = 1$ .
3. Set  $k = 0$ .

4. Find the mismatch vector.

$$\begin{bmatrix} \Delta P_2 \\ \Delta P_3 \\ \Delta Q_3 \end{bmatrix}^0 = \begin{bmatrix} P_{2,sch} - P_2(\delta_2^0, \delta_3^0, |V_3|^0) \\ P_{3,sch} - P_3(\delta_2^0, \delta_3^0, |V_3|^0) \\ Q_{3,sch} - Q_3(\delta_2^0, \delta_3^0, |V_3|^0) \end{bmatrix} = \begin{bmatrix} 0.6661 - 0 \\ -2.8653 - 0 \\ -1.2244 - (-0.52) \end{bmatrix}$$

$$\begin{bmatrix} \Delta P_2 \\ \Delta P_3 \\ \Delta Q_3 \end{bmatrix}^0 = \begin{bmatrix} 0.6661 \\ -2.8653 \\ -0.7044 \end{bmatrix}$$

$$J^0 = \begin{bmatrix} 21 & -10.5 & 0 \\ -10.5 & 20.5 & 0 \\ 0 & 0 & 19.46 \end{bmatrix}$$

5. Solve for the correction vector.

$$\begin{bmatrix} \Delta\delta_2 \\ \Delta\delta_3 \\ \Delta|V_3| \end{bmatrix}^0 = [J^0]^{-1} \begin{bmatrix} \Delta P_2 \\ \Delta P_3 \\ \Delta Q_3 \end{bmatrix}^0$$

$$\begin{bmatrix} \Delta\delta_2 \\ \Delta\delta_3 \\ \Delta|V_3| \end{bmatrix}^0 = \begin{bmatrix} -0.0513 \text{ rad} \\ -0.1660 \text{ rad} \\ -0.0362 \end{bmatrix}$$

6. Find the new estimate.

$$\begin{bmatrix} \delta_2 \\ \delta_3 \\ |V_3| \end{bmatrix}^1 = \begin{bmatrix} \delta_2 \\ \delta_3 \\ |V_3| \end{bmatrix}^0 + \begin{bmatrix} \Delta\delta_2 \\ \Delta\delta_3 \\ \Delta|V_3| \end{bmatrix}^0$$

$$\begin{bmatrix} \delta_2 \\ \delta_3 \\ |V_3| \end{bmatrix}^1 = \begin{bmatrix} 0 \\ 0 \\ 1 \end{bmatrix} + \begin{bmatrix} -0.0513 \\ -0.1660 \\ -0.0362 \end{bmatrix} = \begin{bmatrix} -0.0513 \text{ rad} \\ -0.1660 \text{ rad} \\ 0.9638 \end{bmatrix}$$

7.  $k=k+1$  and go back to step 4.
8. It took 5 iterations to converge.

$$\begin{bmatrix} \delta_2 \\ \delta_3 \\ |V_3| \end{bmatrix} = \begin{bmatrix} -0.0524 \text{ rad} \\ -0.1745 \text{ rad} \\ 0.9500 \end{bmatrix}$$

9. Slack bus power:


$$P_g = 2.1992; Q_g = 0.1387$$

10. Losses :

$$P_L = 0; Q_L = 0.5560$$

### Line Flows, Losses and Slack Bus Power:

Once the bus voltages are found numerically, the next step is to find line flows and losses.

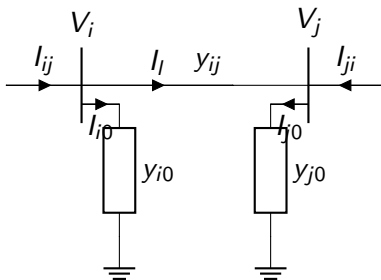

$$I_{ij} = I_l + I_{i0} = y_{ij}(V_i - V_j) + y_{i0}V_i$$

$$I_{ji} = -I_l + I_{j0} = y_{ij}(V_j - V_i) + y_{j0}V_j$$

The complex power  $S_{ij}$  and  $S_{ji}$  are

$$S_{ij} = V_i I_{ij}^*$$

$$S_{ji} = V_j I_{ji}^*$$

The power loss in the line  $i - j$  is

$$S_{L,ij} = S_{ij} + S_{ji}$$

The slack bus power can be computed as follows:


$$P_1 - jQ_1 = V_1^* \sum_{n=1}^N Y_{1n} V_n$$

The Slack bus does the following.

$$P_{G1} = -\left( \sum_{\substack{i \in \text{Gen} \\ i \neq \text{Slack}}} P_{Gi} - \sum_{i \in \text{load}} P_{di} - P_L \right)$$

$$Q_{G1} = -\left( \sum_{\substack{i \in \text{Gen} \\ i \neq \text{Slack}}} Q_{Gi} - \sum_{i \in \text{load}} Q_{di} - Q_L \right)$$

Example : For the system shown in the figure,  $S_{D1}$  and  $S_{D2}$  are complex power demands at bus 1 and bus 2 respectively. If  $|V_2| = 1$  p.u., compute the rating of capacitor ( $Q_{G2}$ ) connected at bus 2 in p.u.

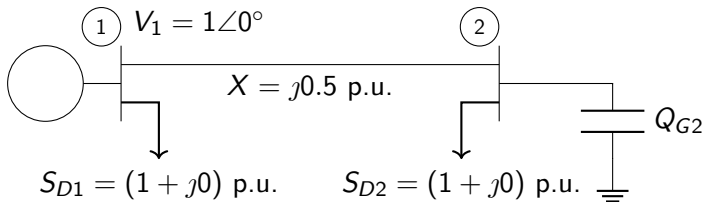

1. Form  $Y_{bus}$  matrix.

$$Y_{bus} = \begin{bmatrix} \frac{1}{j0.5} & -\frac{1}{j0.5} \\ -\frac{1}{j0.5} & \frac{1}{j0.5} \end{bmatrix} = \begin{bmatrix} 2\angle -90^\circ & 2\angle 90^\circ \\ 2\angle 90^\circ & 2\angle -90^\circ \end{bmatrix}$$

2. Since ② is a voltage controlled (*PV*) bus,

$$P_{2,sch} = P_{G2} - P_{D2} = 0 - 1 = -1$$

The net real power injected into the network at ②.

$$P_2 = Y_{21} || V_2 || V_1 | \cos(\theta_{21} + \delta_1 - \delta_2) + Y_{22} || V_2|^2 \cos(\theta_{22})$$

$\delta_2$  can be found directly instead of N-R method for this equation. At ②,

$$P_{2,sch} = P_2$$

On substitution,

$$2 \cos(90^\circ - \delta_2) = -1$$

$$2 \sin \delta_2 = -1$$

$$\delta_2 = -30^\circ$$

3.  $Q_{G2}$  is found as follows:

$$Q_{2,sch} = Q_{G2} - Q_{D2} = Q_{G2}$$

The net reactive power injected into the network at ②.

$$Q_2 = -Y_{21}||V_2||V_1|\sin(\theta_{21} + \delta_1 - \delta_2) - Y_{22}||V_2|^2\sin(\theta_{22})$$

On substitution,

$$Q_2 = -2\sin(120^\circ) + 2 = 0.2679$$

At ②,

$$Q_{2,sch} = Q_2$$

Therefore,

$$Q_{G2} = 0.2679 \text{ p.u.}$$